




ISO9001 CE RoHS 🚔 📣











OPERATING MANUAL



HK-60Q-V Electric Plastic Ball Valve



Introduction

PVC ball valves are widely used in water management and irrigation and is suitable for corrosive media, such as sea water. Moreover, the plastic material is resistant to most acids and bases, salt solutions and organic solvents. PVC is not resistant to aromatic and chlorinated hydrocarbons. The maximum medium temperature is about 60°C(140°F).



Electric Actuator

ON/OFF Type	Feedback: the Active Contact Signal, Passive Contact Signal, Resistance, 4-20mA
Regulation Type	Input & Output Signal: DC 4-20mA, DC 0-10V, DC 1-5V
Field Operation	The Field, Remote Control Switch Regulation and MODBUS, PROFIBUS Field Bus
Voltage Optional	AC110–240V 380V 50/60Hz; DC12V, DC24V, Special Voltage Can be Customized
Protection Class	Ip65; Explosion Proof Construption Are Acailable: EX d II BT4

Technical Parameters

Val	ve Body	Valve Components			
Size Range	DN15-DN400	Body Material	UPVC/CPVC		
Operating Pressure	1.0MPa, 1.6MPa	Core Material	UPVC/CPVC		
End Connection	Flange, Thread, Union	Sealing Material	PTFE, NBR, EPDM		
Structure	Straight Through Flow Path	Applicable Media	Compatible PVC Food Industry Chemical Solvents		

Product Weight

N.W.(KG)	DN15	DN20	DN25	DN32	DN40	DN50	DN65	DN80	DN100
Actuator	3.1	3.1	3.1	3.1	3.1	3.1	4.6	4.6	4.6
Valve Body	0.3	0.4	0.55	0.78	1.5	2.0	3.0	4.8	8.0



Outline Size Dimension Unit: mm Outer Outer ≥20 21.3 Ø26.7 ≥33.4 VC 235PSI-PN1 042.2 ≥40 ≥50 ≥48.3 ≥63 Ø60.3 73.5 ø73 Ø75 ∅90 ₽88.9 @110 Ø114.3 e140 Ø1413 ø160 ø168.3 ø225 DN200 **∞273** @315 Ø324 Ø355 @355.6

Products Performance Specification

	01-			Nomina	l Pressur	e (MPa)				Pound	(Class)	
Pres	sure Class	0.6	1.0	1.6	2.5	4.0	6.4	10.0	150	300	400	600
Tooting	Shell Test	0.9	1.5	2.4	3.75	6.0	9.6	15.0	3.03	7.5	10.2	15.0
Testing Pressure (MPa)	Sealing Test	0.66	1.1	1.76	2.75	4.4	7.04	11.0	2.2	5.5	7.48	11.0
(ivii a)	Air Sealing Test						0.6MPa					
						В	ody Mater	ials				
Appile	able Medium		С				Р				R	
	NOTES SELECTION OF THE SE		ater, Vap	or, Oil and Gas etc.	t		ive Mediu Nitric Acid		1		Ediums Setic Acid e	

Installation Instruction

- 1. Before installing the valve, clean the line of dirt, scale, welding chips, and other foreign material. Clean gasket surfaces thoroughly to insure leak-proof joints.
- 2. Check flow direction to be sure valve is installed correctly. Fail-closed valves should be installed with the shaft upstream only in gas service. It's preferred that liquid service valves be installed with the shaft downstream regardless of air failure action. However, under certain flow conditions the valve can flow shaft upstream. Consult the factory if the valve must be mounted with the shaft upstream in liquid service. Fail-open valves should be installed with the shaft downstream.
- 3. Fully close the valve before and during the installation process. Keep hands, hair, clothing, etc. away from the rotating disc and the seat when operating the valve. Failure to do so could cause serious injury.
- 4. Make sure proper clearance exists internally in the mating piping to permit proper disc rotation.
- 5. Any mechanical stops that would interfere with the operation of the actuator must be removed before installation of the actuator, i.e. lever, travel stops, etc.



Main Functions and Key Features

- Body: body material is hard aluminum alloy, which is treated by hard anodic oxdization and coated by Polyester powder, so that it has great corrosion resistance and protection class is IP67.
- 2. Motor: fully enclosed cage type motor is small in size and inertia, large in torque. Insulation class is F grade which can prevent motor over-heating;
- Manual Override: small handle is reliable, energy-saving. It can be used for manual operation when electricity is off; In automatic operation, it can be fixed inside the clip for easy operation;
- Indicator: indicator is assembled on center axis, valve position can be observed;
 Outside mirror design facilitates position observation and prevents water drops accumulation;
- 5. Enclosure: high sealing performance, standard protection class is IP67;
- Limit Switches: mechanical and electronic position limit switches. Mechanica stop Iscrew can be adjustable; Electronic limit switches can be controlled by cam. Position can be set easily and accurately by simply adjusting the cam without any influence by handle;
- 7. Self Lock: accurate turbo—worm structure can output large torque with high efficiency and little noise (Max. 50 decibel). Service life is quite long. Its self lock function can stop reverse rotation. Drive part is stable and reliable without additional lubrication;
- 8. Captive Bolt: bolts won't fall off when cover is disassembled;
- Application: bottom connection complies with ISO5211/DIN3337 Standard. Star square hole is easy for square valve stem linear or 45° rotation application; Both vertical and horizontal assemble are available;
- 10. Diagram: control diagram complies with single phase or three phase wiring standard, reasonable wiring diagram and connection terminal can meet requirement of other optional functions.







ON/OFF Type



Regulation Type





Intelligent Type






COVNA-05








178
88
90
COVNA-05
12
12
12
12
12
12
13




COVNA-10/16















COVNA-30/60











COVNA-125/250/400

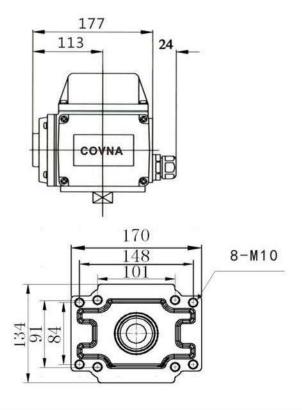

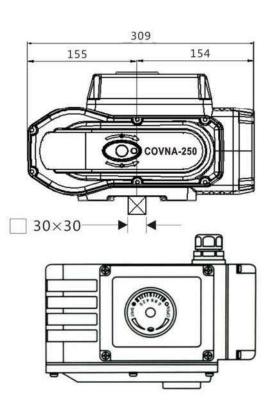



Technical Parameters of Electric Actuator

ON/OFF Type

Model Performance	05	10	16	30	60	125	250	400
Torque Output	50Nm	100Nm	160Nm	300Nm	600Nm	1250Nm	2500Nm	4000Nm
90° Cycle Time	20S/60S	1	5S/30S/60	S	30S/60S	100S	100S	100S
Angle of Rotation	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°
Working Current	0.25A	0.48A	0.68A	0.8A	1.2A	2A	2A	2.7A
Starting Current	0.25A	0.48A	0.72A	0.86A	1.38A	2.3A	2.3A	3A
Drive Motor	10W/F	25W/F	30W/F	40W/F	90W/F	100W/F	120W/F	140W/F
Product Weight	3KG	5KG	5.5KG	8KG	8.5KG	15KG	15.5KG	16KG
Voltage Options	AC110	V, AC220\	/, AC380V,	DC24V, A	C24V	*		
Insulation Resistance	DC24V	: 100MΩ/2	50V; AC11	0/220V/380	OV: 100MΩ	2/500V		
Withstand Voltage	DC24V	: 500V; AC	110/220V:	1500V; AC	380V: 180	0V 1Minute)	
Protection Class	IP65							
Installation Angle	Any							
Electrical Connection	G1/2 W	ater-proof	Cable Con	nectors, El	ectric Pow	er Wire, Siç	gnal Wire	
Ambient Temp.	-30°C 1	to +60°C						
Control Circuit	B: ON/O C: ON/O D: ON/O E: Regu F: DC2 ² G: AC38	OFF Type w OFF Type w OFF Type w lation Type 4V/ DC12V BOV Three-I	with Servo (Direct ON/O Phase Powe	Contact Sigr ce Potention ce Potention Control Mod FF Type er Supply wit	nal Feedbace meter Signa meter and N lule th Passive S	l Feedback leutral Positi Signal Feedb	on Signal Fe back neter Signal F	
Optional Function							oupling & Y	



Regulation Type


Model Performance	05	10	16	30	60	125	250	400
Torque Output	50Nm	100Nm	160Nm	300Nm	600Nm	1250Nm	2500Nm	4000Nm
90° Cycle Time	208	15S/30S	15S/30S	15S/30S	30S	1008	100S	100S
Angle of Rotation	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°	0-90°
Working Current	0.25A	0.48A	0.68A	0.8A	1.2A	2A	2A	2.7A
Starting Current	0.25A	0.48A	0.72A	0.86A	1.38A	2.3A	2.3A	3 A
Drive Motor	10W/F	25W/F	30W/F	40W/F	90W/F	100W/F	120W/F	140W/F
Product Weight	3KG	5KG	5.5KG	8KG	8.5KG	15KG	15.5KG	16KG
Voltage Options	AC11	0V, AC220	OV, AC380	V, DC24V	, AC24V			
Input Signal	4-20n	nADC 1-	5VDC 0	-10VDC				
Output Signal	4-20n	nADC 1-	5VDC 0	-10VDC				
Tolerance	±0.59	%						
Return Difference	<0.3%	6						
Dead Zone	0.1%	to 1.6%						
Damping Characteristics	0							
Mechanical Repeatability Error	0%							

Note:

90°Cycle Time: travel from closed position to open position or vice versa


Duty Cycle for 24VAC will be approximately 20%





A: ON/OFF Type with Light Indicator Signal Feedback


Function: Finish open or close operations by the circuit, and the actuator outputs a signal of active position (full opening, full closing)



B: ON/OFF Type with Passive Contact Signal Feedback

Function: Finish open or close operations by the circuit, and the actuator outputs a set signal of passive position (full opening, full closing)


Structure: with two neutral positions switches



C: ON/OFF Type with Resistance Potentiometer Signal Feedback

Function:Control the open angle of valves by circuit, and the actuator outputs the resistance signal corresponding to the position of switch

Structure: with 500Ω or 1000Ω potentiometer



D: ON/OFF Type with Resistance Potentiometer and Neutral Position Signal Feedback


Function: control the open angle of valves by circuit, and the actuator outputs the resistance signal corresponding to the position of open position, at the same time, outputting a set signal of passive position

Structure: both potentiometer style and neutral positions switch style

Caution:

Can't connect one actuator parallel with other ones, in other words, can't use the same control -ler contact points to control two and above actuators, otherwise it will cost out of control, motor overheating, product damage and shorter service life.



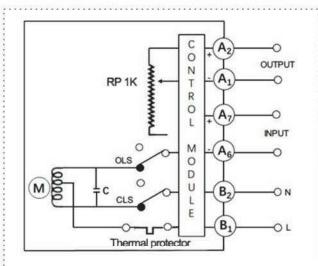


E: Regulation Type with Servo Control Module

Function: Modulating, input & output

DC4-20mA, 1-5VDC, 0-10VDC


Structure: With servo control module and

1000Ω potentiometer

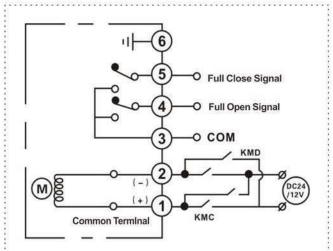

F: DC24V/ DC12V Direct ON-OFF Type

Function: The external circuit make positive and negative conversion of DC power to open or close, and the actuator outputs a set signal of passive position (full opening, full closing)




G: AC380V Three-Phase Power Supply with Passive Signal Feedback

Function: The external circuit make positive and negative conversion of DC power to open or close, and the actuator outputs a set signal of passive position (full opening, full closing)

Notes:

Please kindly note if the switch position is correct when the three phase electric actuator is being adjusted, if it's opposite direction, then make 2 of power lines exchange each other



H: AC380V Three-Phase Power Supply with Resistance Potentiometer Signal Feedback

Function: The external circuit make positive and negative conversion of DC power to open or close, and the actuator outputs a set signal of passive position (full opening, full closing)


Notes

Please kindly note if the switch position is correct when the three phase electric actuator is being adjusted, if it's opposite direction, then make 2 of power lines exchange each other

Caution:

Can't connect one actuator parallel with other ones, in other words, can't use the same control -ler contact points to control two and above actuators, otherwise it will cost out of control, motor overheating, product damage and shorter service life.



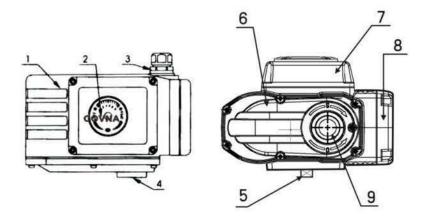

Construction							
1	Shell	4	Rubber Cap	7	Electric Cover		
2	Position Indicator	5	Output Shaft	8	Terminal Box		
3	Inlet Wire Lock	6	Gear Box Cover	9	Manual Override		

The actuator are fully debugged before they go out, if they don't meet your demands because of the valve body, the coupling in actual installation. Please resume debugging according to following steps:

- Assembly the actuator to the valve (refer to Installation)
- Discharge the electric cover of actuator and debug as following steps according to the actual state of valve:
 - ① Adjustment of limit position switch (refer to Commissioning);
 - ② Adjustment of neural position switch (refer to Commissioning);
 - 3 Adjustment of regulation type actuator (only for E style, refer to Commissioning of regulation type actuator);
 - ④ Adjustment of mechanical limited location block (refer to *Commissioning*).

The manual test run

- ① Take off the rubber cap of manual handle hole; inset the hand shank into hole and rotate it clockwise decreased valve opening.
- ② Check whether the limit switch is running or not when the valve is full closing position (sensitive switch making crack sound when it is running), then turn the adjusting screw a half turn to check if the screw could touch the mechanical limited location block.
- ③ Turn hand shank anticlockwise to increase valve opening, check the situation of limit switch and mechanical limit location block the same method, make trial turn to see whether they are all right.

• The electric test run

- 1 Take off terminal box, wiring correctly according to wiring diagram
- ② Separately turn on the power on clockwise and anticlockwise and see whether the actuator and the valve are working correctly.) The direction of shut point (clockwise) show close, the direction of open point (anticlockwise) show open.

Electric Actuator

Parallelism<0.5mm

Valve Body

Cable Wire

Lock Nut



1. Installation environment

- The product can be installed indoor and outdoor.
- product is non-explosion-proof production, and the installation must be avoided being in flammable or explosive environment etc.
- The actuator should be in protection box in the environment of long-term with the splash of rain, material and direct sunlight.

Couplings

Bracket

Please reserve space for controller, manual operation.


★ The surrounding environment temperature should be in -30°C~+60°C

2. Temperature of working medium

- When matching with the valve, the actuator body's temperature will a bit rise if medium temperature happen heat transfer.
- If the temperature of medium is high, the bracket has the function of reducing heat conduction.
- Please select the standard bracket if temperature of working medium below 60°C.
- Please select the standard bracket when temperature of working medium above 60°C.

3. Installed on the valve body (Figure 3)

- Manually operate the actuator to drive the valve, confirm it does not have abnormal situation. Turn the valve in full closed position.
- . Assemble the bracket to the valve body.
- · Set one end of couplings on valve spindle.
- Turn the electric actuator to full closing position, and insert output-input shaft into the square holes of couplings.
- · Set the screw between the electric actuator and bracket.
- Turn actuator by hand shank, confirm that it moves translation, no eccentric, no skew and no overrun.



4. Cable installation

- . Install wire tubes as shown in Figure 4.
- The outside diameter of wire tubes should be Ø9-Ø11.
- · Take measures to proof water.
- To prevent actuator from flowing into wire tubes water, the actuation position should higher than wire tubes position.
- When installing wire, the outside diameter of wire should be Ø9-Ø11.
- As figure 5, in case the water flow into actuator interior from line locking, all wire that are not allowed to be used.
- The signal wire should be shielded wire in principle, don't parallel it to power wire.

5. Special tips

• Caution: can't connect one actuator parallel with one another, in other words, can't use the same controller contact point to control more than one actuator, otherwise it will cause out of control, motor overheating, product damage, shorter service life.

 If the actuator is installed outdoor, we suggest equipping other protective cover to proof water, stabilize mechanical property, make a longer service life.

6. Power voltage: 220VAC 50Hz/60Hz

7. Guard line options for witch of cutting-off winding

Item	Guard Line	Motor Power W/F
05	3A	10
10/16	5A	25, 30
30/60	7A	40, 90
125/250/400	10A	100, 120, 140





Figure 4

11






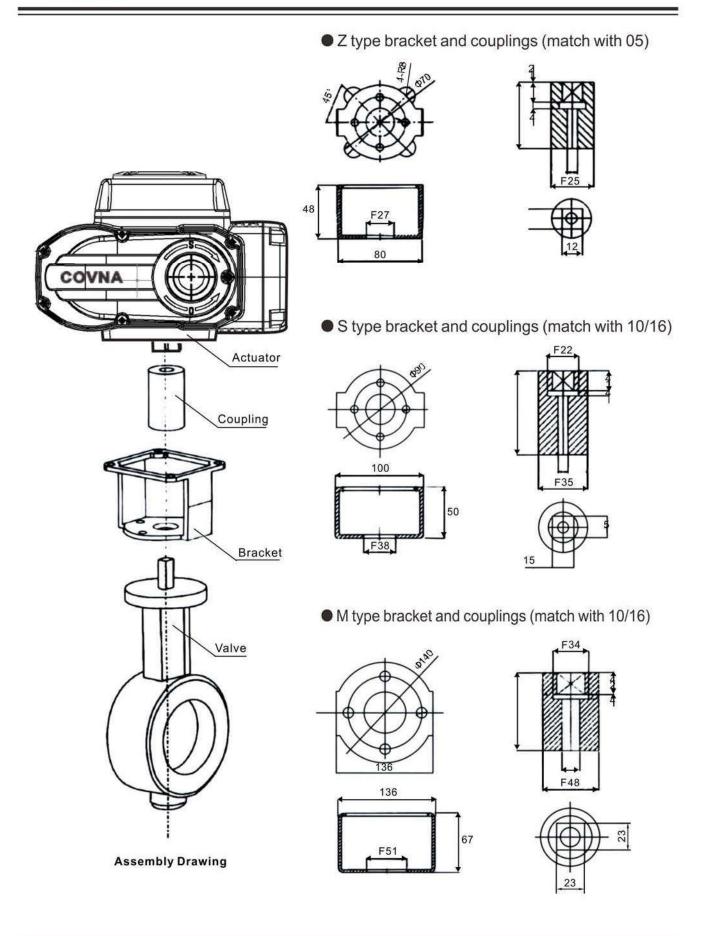

1. Adjustment of limit position switch (Figure 6)


- Turn the valve to full opening position by hand.
- Loosen the screw of travel block and turn the block to drive the travel switch, then fine-tuning sensitive switch until hearing "click", after that, set screw.
- The way of adjustment full opening position is the same as above.

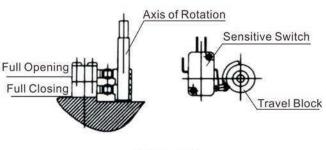

(Figure 6)

2. Adjustment of middle position switch (Figure 7)

- Use hand shank to drive the valve to the position it need.
- Loosen the screw of travel block and turn the travel block
 Middle Position
 Middle Position
- These two neutral position switches' position could be adjusted according to need.

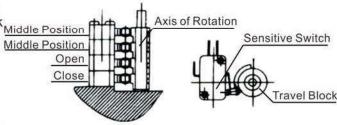


(Figure 7)

3. Adjustment of potentiometer (Figure 8)

- Use hand shank to drive actuator to neutral position, and turn the pointer point to 50% scale line.
- Use multimeter to test resistance of first and third port of potentiometer (resistance between the first port and third port in potentiometer), and mark R (potentiometer default is 1KΩ ±15% if no special request).
- Separate potentiometer gear from the opening gear by suitable external force on potentiometer fixing plate.
- Put one probe of multimeter to one potentiometer terminal, the other probe to another terminal, then rotate potentiometer gear and see number in multimeter. When the resistance value is equivalent to R/2 ±2Ω, stop rotating, after that, mesh these two gears.

4. Adjustment of mechanical limit location block (Figure 9)

- Use hand shank to drive valve to full opening position and operate the switch (sensitive switch makes crack sound when it is running).
- Loosen the nut and turn the adjusting screw to touch the mechanical limit location block, then turn the adjust
 -ing screw a half turn back, set nut.
- Adjusting the full opening position by the same way as above.

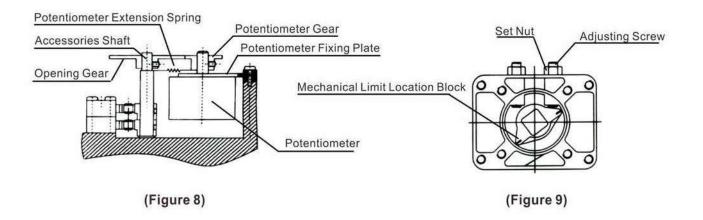

Commissioning of Regulation Type Actuator

1. Function of electrical limit and mechanical limit

- ① Electrical stroke limit function:
 - When the actuator reaches at fully opened/fully closed or the middle position, the bullt-in electrical limit switch will cut off the circuit to protect the actuator.
- ② Mechanical limit function of output shaft:
 When electrical stroke limit function fails, output shaft Will be locked by mechanical limit to protect the valve from damage.


Figure 10 shows the position relationship between electrical limit and mechanical limit.

2. Adjustment of actuator (Figure 10)


- ① Adjust the over-travel limit stopper to zero position and full position, and ensure electrical limit position angle is 90°.
- 2 Adjust mechanical position limitation base on electrical limit position angle.

3. Connection of actuator with servo control module

- Potentiometer installation and connection (Figure 11)
- ① Finish potentiometer installation and connection according to "Commission" in previous chapter.
- ② Use multimeter to check resistance of potentiometer in middle opening position, and ensure it has homogeneous continuous variable from 0-100% opening.

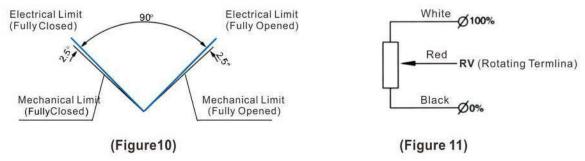


• Electrical wiring of the servo control module (Figure 12)

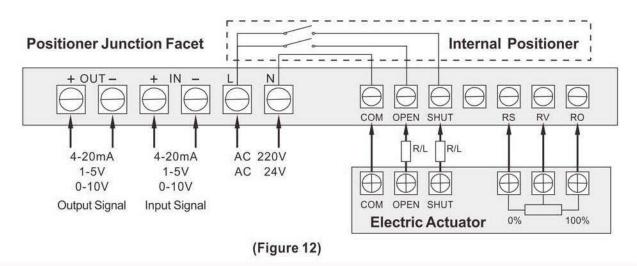



Commissioning of Regulation Type Actuator

Module Operating Interface



	1	OPEN	Output control "open"
Status indication	2	SHUT	Output control "shut"
	3	MANU	Manual control status
	4	AUTO	Auto control status
	5	DRTA	Operating by clockwise, the input signal is corresponding to 4mA-full position (usually we calibrate it to be full opening), 20mA-zero position (usually we set it to be full closing)
Mode	6	RVSA	Operating by anticlockwise, the input signal is corresponding to 4mA-full position (usually we set it to be full opening), 20mA-zero position (usually we calibrate it to be full closing)
indication	7	OPEN	Input opening signal to make the actuator open to maximum opening degree
	8	STOP	Input stopping signal to make the actuator stop running
	9	SHUT	Input shutting signal to make the actuator shut to minimum closing degree
	10	A/M	Automatic or manual mode toggle key, parameter change and toggle key
Button	11	A	Values increase button, it use for switching display to original set degree of opening, when it's in automatic mode, opening action when it's maual mode
	12	•	Values decrease button, it's use for switching display to the temperature of valve positioner shell when it's in automatic mode

4. Zero Calibration


After wiring between valve positioner and actuator like Figure 12, the rotation angle has to be calibrated in the first match between positioner and actuator, after that the positioner could work correctly, the demarcation has no effect on input and output of valve positioner.

Method one: simple automatic calibration (this method request the actuator has electric limit position stopper and mechanical limit position stopper). In the automatic mode, press both A/M and buttons at the same time, then release these two buttons at the same time, the actuator will start automatic calibration and confirm the zero position (full closing) first. The valve runs to the small angle direction and reaches at minimal opening position which is judged as zero position (valve position 0.0). After that the actuator runs to maximum opening direction and reaches at maximum opening position which is judged as full position (valve position 100.0). After judgment, the actuator returns to automatic calibration and saves results by itself.

Method two: calibrate your need (this method request button idle time less than 8 seconds in the progress of calibration). In the automatic mode, press A/M button into u0 parameter, pass u1, u2, u3, u4 and into u5, revise u5=003.1, finally press A/M button.

- ① Enter u6, press ▲ or ▼ button to make actuator to run to "open" or "shut" direction, meanwhile, the screen shows the situation of actual valve opening degree is increasing or decreasing. If the opening arrival at Zero position that it's your expected position (you can see it if actuator is already assembled valve body, and the valve is set in full closing position in general), press A/M button to confirm it, enter u7 parameter.
- ② In u7 parameter, press ▲ or ▼ to run to your expected full position in the same way, and press A/M to confirm full position (you can see it If actuator is already assembled valve body, and the valve is set in full opening position in general), then back to u5.
- ③ Revise u-00.5 and back to measurement and control status.



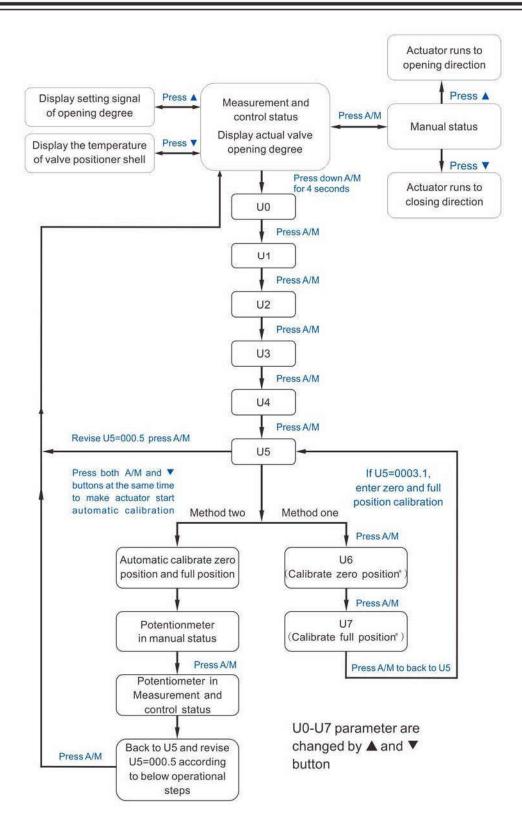

NOTE: Each parameters of regulation type actuator have already been calibrated before leaving factory. Do not alter it unless it must. If really do, please read it carefully before commissioning.



5. Error message and solution

Error Code	Meaning	
E-01	For example, the signal of zero position is calibrate to be 4mA, but the given current ≤3.0mA. The actuator will start signal interrupt handler and show E-01 in screen	
E-03	Signal feedback lines of valve positioner and actuator are inversely connected Switch lines are inversely connect	
E-05	The actuator has large oscillation because of input signal or feedback signal unstable, too hig precision, etc	
E-06	The actuator isn't able to open direction	
E-07	The actuator isn't able to run to shut direction	
E-08	The Internal temperature of positioner is higher than 80°C	

Maintenance

- ① No extra oil required because the molybdenum grease we put are with long service life and high withstand voltage.
- ② Please take periodical inspection to the actuator if you don't use it frequently.

Troubleshooting

Fault phenomenon	Possible reason	Solution	
	Lacking of power supply	Connect the actuator to power supply	
	Electric wire broken, wiring terminals loose	Repair the wire, tighten wiring terminals	
Matar dans not start	Supply voltage is wrong or below level	Check the voltage is correct or wrong	
Motor does not start	Overheat protector activated (ambient temperature is too high, the valve is stuck)	Reduce ambient temperature, manually open/close the valve to see if it is working	
	Limit switch disfunction	Replace the limit switch	
	Capacitance doesn't start or running	Replace the capacitance	
Opening & closing	Indicator light is broken	Replace the indicator light	
Indicator light doesn't	Limit switch disfunction	Replace the limit switch	
light	Adjusting of block disfunction	Readjustment	
	Signal source has interference signal	Check input signal	
Opening degree chang- ing constantly	Voltage divider generated interference	Replace the potentiometer	
	Voltage divider gear or opening gear loose	Tightening up the screws of gear	